


PLAN

REINFORCEMENT NOTE

THICKNESS	TYPE OF REINFORCEMENT
4"	6"x6"x6" MESH
6"	1/2" DIA. BAR (BOTH WAYS)

ADJUST TO FINISHED GRADE WITH APPROVED RUBBER EXTENSION RINGS, MAXIMUM 12". UTILIZE ADHESIVE BETWEEN EXTENSION RINGS. INSTALL RAM-NEK PLASTIC GASKET BETWEEN BOTTOM RING AND PRECAST TOP SECTION AND BETWEEN TOP RING AND MANHOLE FRAME.

STANDARD MANHOLE FRAME AND COVER
 CASTING RIM AND BOLTS SHALL BE COVERED WITH MORTAR IF EXPOSED ABOVE FINISHED GRADE
 (4) MALLEABLE IRON THREADED INSERTS FOR 3/4" DIA. BOLTS AT 28"± O.C. INSTALLED IN PRECAST MANHOLE

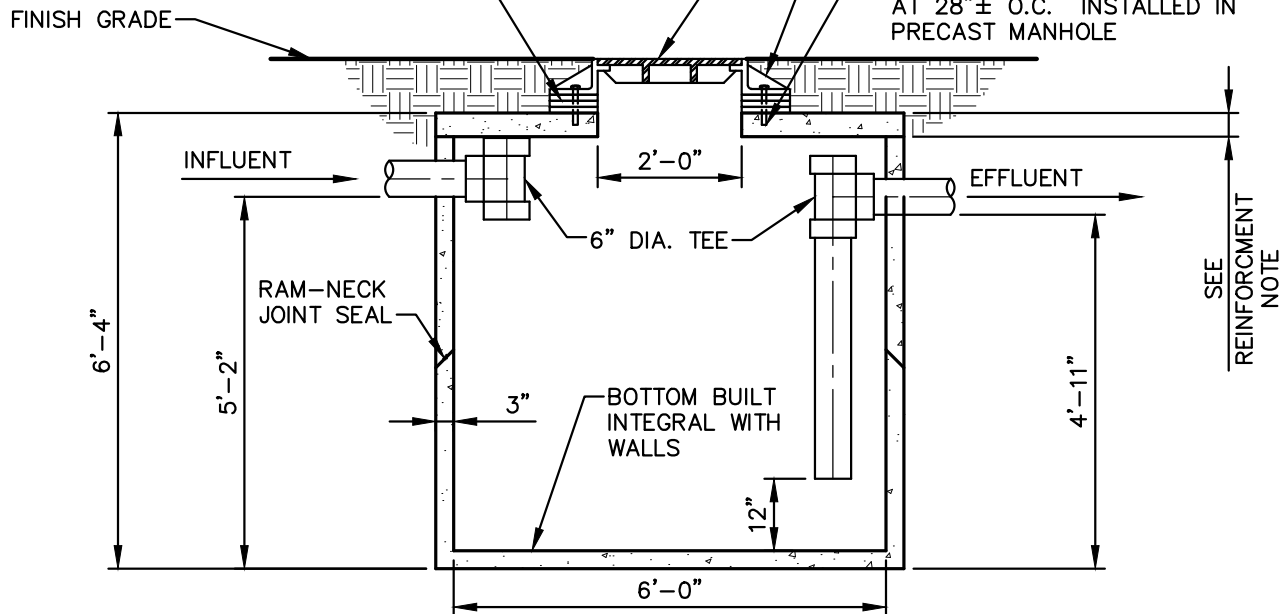

SECTION

1000 GALLON GREASE TRAP

NOT TO SCALE

1000 GALLON GREASE TRAP

SPRING - BENNER - WALKER
 JOINT AUTHORITY

DATE	10/11/23
SCALE	NTS
PROJECT	
SHEET	28